

# Test Report

No.: SHAEC23021891705

Date: Jan 16, 2024

Page 1 of 9

**Test Report**

**No.:** SHAEC23021891705

**Date:** Jan 16, 2024

Page 2 of 9

**Test Result(s):**

Test Part Description



# Test Report

No.: SHAEC23021891705

Date: Jan 16, 2024

Page 3 of 9

Test Item(s)	Limit	Unit(s)	MDL	A2
Dibutyl Phthalate(DBP)	1000	mg/kg	50	ND
Diisobutyl Phthalate(DIBP)	1000	mg/kg	50	ND

**Notes:**

- (1) The maximum permissible limit is quoted from RoHS Directive (EU) 2015/863.
- (2) IEC 62321 series is equivalent to EN 62321 series.
- (3) The restriction of DEHP, BBP, DBP and DIBP shall apply to medical devices, including in vitro medical devices, and monitoring and control instruments, including industrial monitoring and control instruments, from 22 July 2021.


**Halogen**

Test Method:





### Elements Testing Flow Chart


These samples were dissolved totally by pre-conditioning method according to below flow chart.

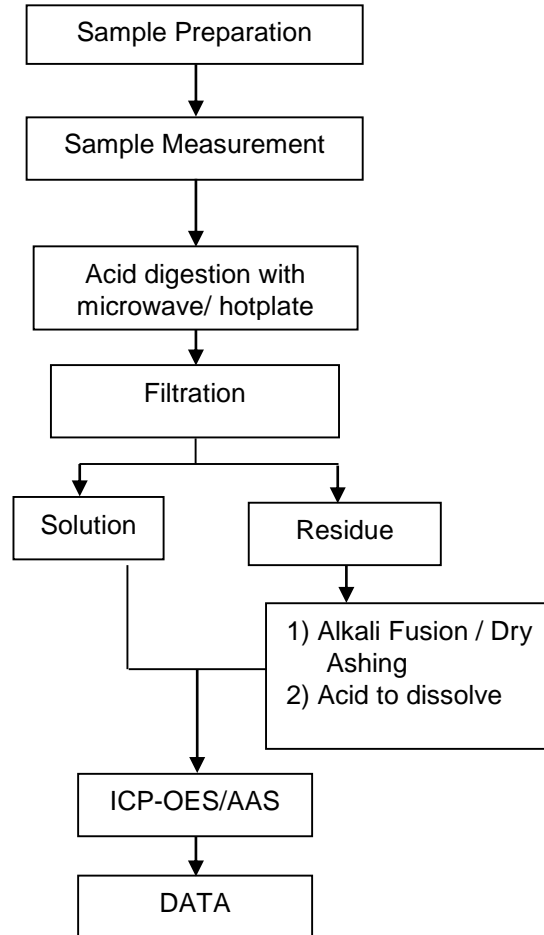

**Hexavalent Chromium (Cr(VI)) Testing Flow Chart**

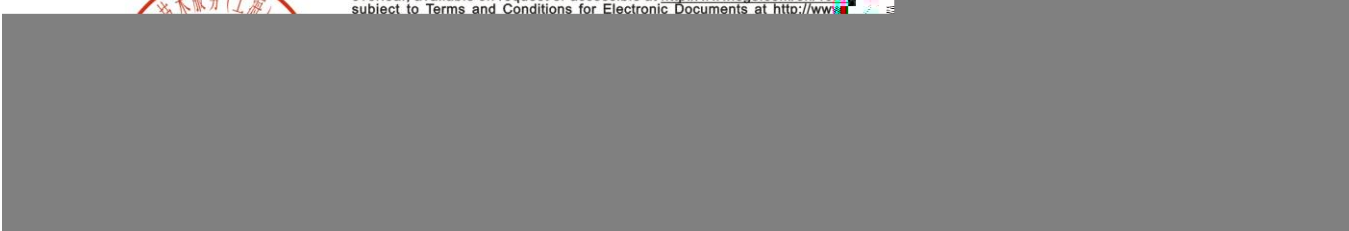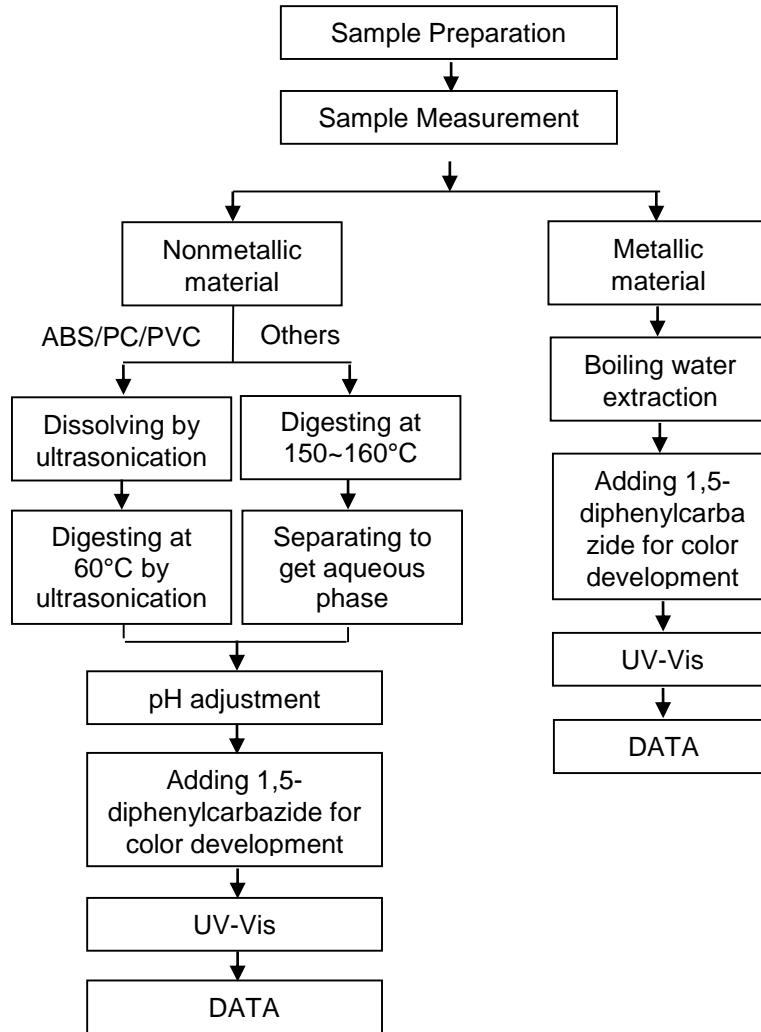


### PBBs/PBDEs Testing Flow Chart

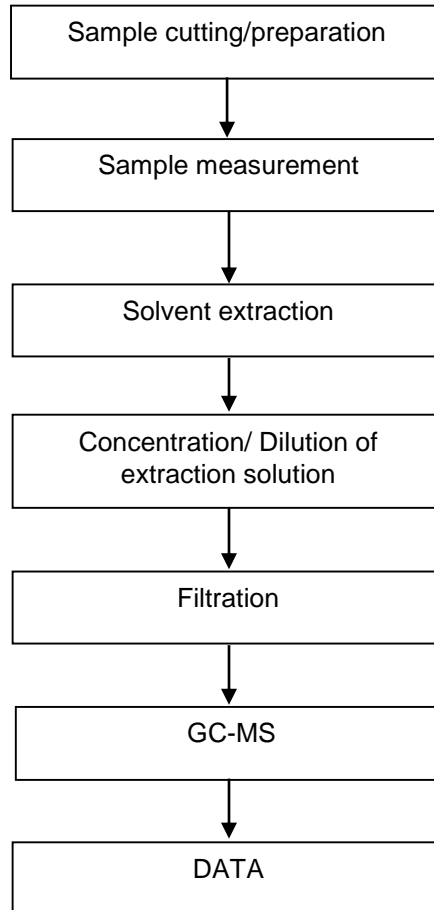

# Test Report

### Halogen Testing Flow Chart

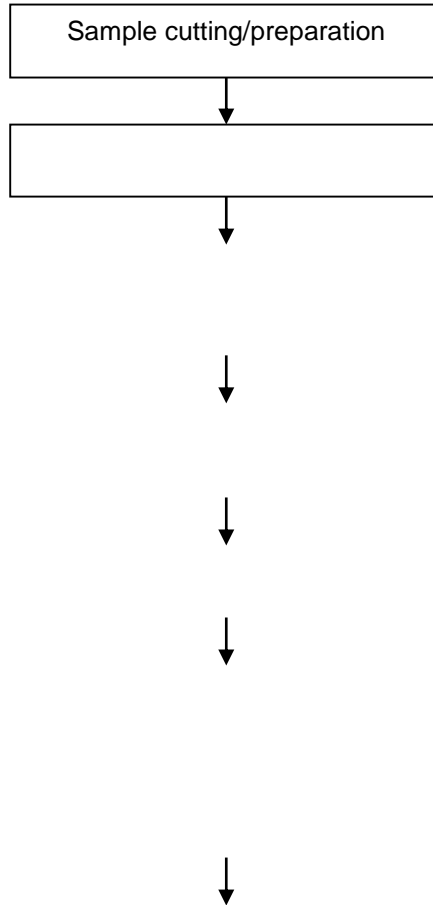


## Test Report

No.: SHAEC23021891705

Date: Jan 16, 2024

Page 9 of 9

Sample Photo:

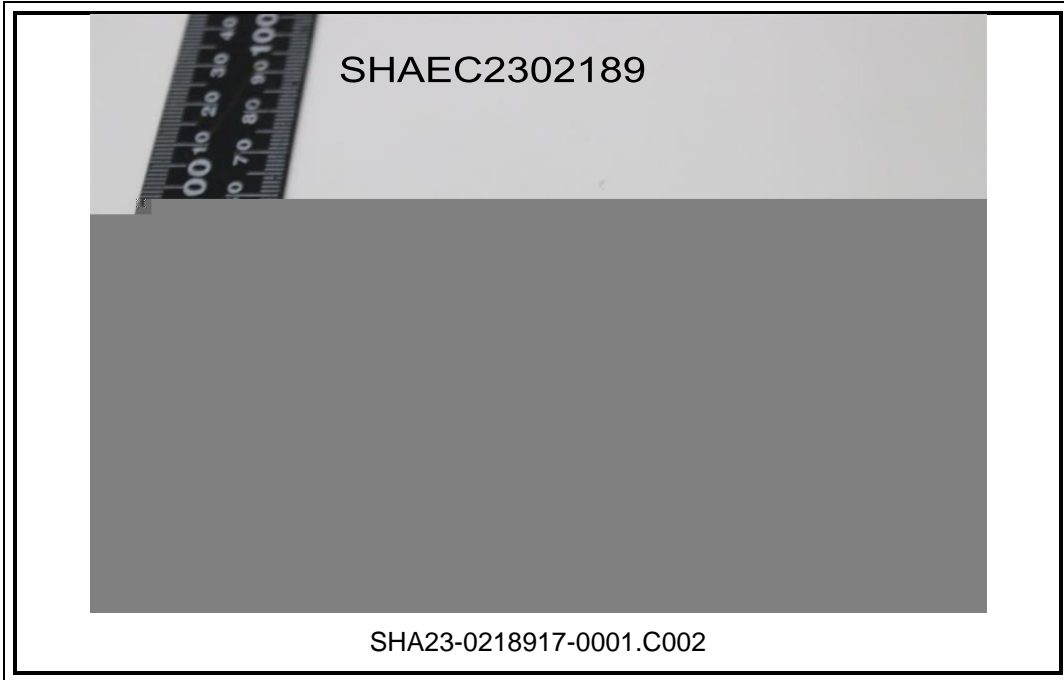

SGS authenticate the photo on original report only  
\*\*\* End of Report \*\*\*

